


NOTES:
 ALL LINES IN THIS AREA BELOW 18" A.F.F. SHALL BE IN ACCORDANCE WITH CLASS 1, DIVISION 2, OF THE NATIONAL ELECTRICAL CODE.

NOTE:
 ALL LINES IN THIS AREA BELOW 18" A.F.F. SHALL BE IN ACCORDANCE WITH CLASS 1, DIVISION 2, OF THE NATIONAL ELECTRICAL CODE.

NOTE:
 ALL LINES IN THIS AREA BELOW 18" A.F.F. SHALL BE IN ACCORDANCE WITH CLASS 1, DIVISION 2, OF THE NATIONAL ELECTRICAL CODE.

PLAN NOTES


- ◆ JUNCTION BOX MOUNTED ABOVE CEILING
- ◆ "DOOR CLOSED" LIMIT SWITCH TO FACILITY JUNCTION BOX
- ◆ TO NEAREST 120 VOLT UNSWITCHED CIRCUIT TO CONTACTOR CABINET

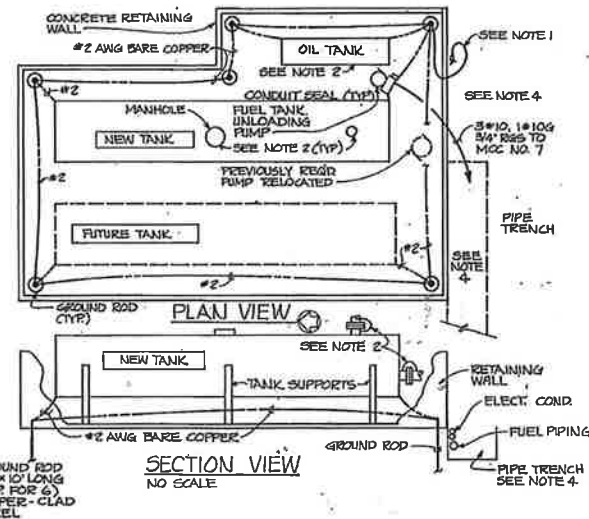

- NOTES**
1. INSTALL 25 LF OF #4 AWG COPPER WITH OIL RESISTANT INSULATED CABLE TO GROUND ROD. INSTALL COPPER ALLIGATOR CLIP TO OTHER END OF CABLE.
 2. BOND ACROSS ALL VALVES, PIPING FLANGES, MANHOLES & GAUGES WITH #4 AWG COPPER GROUND WIRE.
 3. SEE SHEETS T19 & T25 FOR ADD'L REQUIRED ELECT. WORK.
 4. INSTALL ELECT. CONDUITS ABOVE FUEL PIPING (NEAR TOP OF THE TRENCH) IN THE PIPE TRENCH.

FUEL OIL STORAGE TANK
 SCALE: 1/4" = 1'-0"

FLOOR PLAN
 SCALE: 1/4" = 1'-0"



I HEREBY CERTIFY THAT THIS PLAN, SPECIFICATION OR REPORT WAS PREPARED BY ME OR UNDER MY DIRECT SUPERVISION AND THAT I AM DULY REGISTERED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF MISSISSIPPI.

Leo P. Ellison
 1/18/85

STEVENS ENGINEERS INC.
 STRUCTURAL
 MUNICIPAL

REV.	DATE	APPR.	DESCRIPTION	BY
DESIGNED BY	DJB		U.S. COAST GUARD HEADQUARTERS, WASHINGTON, D.C. CIVIL ENGINEERING	
DRAWN	PJB			
TRACED				
CHECKED BY	GPE		ENGINE TEST & REPAIR FACILITY AIRCRAFT REPAIR AND SUPPLY CENTER ELIZABETH CITY, N.C.	
REVIEWED BY				
REVIEWED BY			ELECTRICAL PLAN	
REVIEWED BY				
REVIEWED BY				
APPROVED		<i>PK Valade</i>		DATE 1/18/85
LEE WAN & ASSOCIATES, INC.			PROJECT NUMBER 400185	T19